


Symbol	Description
⊙	DUPLEX
⊙ SPEC.	DUPLEX-MOUNTED SPEC. HT. TO GENTLEMAN OR BOX
⊙	DUPLEX WITH GROUND FAULT INTERRUPTER
⊙	WEATHER PROOF DUPLEX
⊙	FLOOR MOUNT DUPLEX
⊙	QUADRAPLEX
⊙	220V OUTLET
⊙	TELEPHONE
⊙	TELE/DATA
⊙	TELEPHONE/DATA FLOOR
⊙	HORN/STOBE-ELECTRICIAN TO PROVIDE DBL. GANG BOX
⊙	STOBE-ELECTRICIAN TO PROVIDE DBL. GANG BOX
⊙	EI 2000 E-STYLE FLUSH MOUNT BACKLIT KEYPAD
⊙	EI EZ-REX PAD
⊙	ALARM KEYPAD
⊙	ALARM PANEL
⊙	EI MAX 3 PANEL ACCESS SYSTEM
⊙	FIRE PULL
⊙	SMOKE DETECTOR BY FIRE ALARM CONTRACTOR
⊙	POWER POLE - PROVIDED BY TENDANT, ELECTRICIAN TO WIRE TO POWER POLES & MOUNTED BY OWNER
⊙	NETWORK CONTROLLER XC-SSA2/CLK W/ (2) XC-TBC TERMINAL BOARDS W/ CASE & XC-LAN232 LAN ADAPTER

ELECTRICAL PLAN
SCALE: 3/16" = 1'-0"

ACCESSIBILITY COMPLIANCE NOTES

1. ALL NEW TELEPHONE JACKS AND ELECTRICAL RECEPTACLES SHALL BE MOUNTED 15" ABOVE FLOOR TO BOTTOM OF OUTLET BOX. UNLESS OTHERWISE NOTED FOR SPECIFIC USE.
2. ALL MEASUREMENTS ARE TO CENTER OF J-BOX.
3. ALL RECEPTACLES & PLATES TO BE WHITE.
4. PROVIDE KEYLESS LIGHT FIXTURES IN ATTIC SPACE ABOVE DECKED AREA W/ (1) SWITCH NEAR EACH ACCESS LADDER.
5. ALL ELECTRICAL PANELS, TIMERS, ETC. TO BE CLEARLY LABELED BY ELECTRICAL CONTRACTOR.
6. PROVIDE CONDUIT STUB-UPS TO ALL CONDENSERS.
7. ALL ISLANDS TO RECEIVE POWER THROUGH FLOOR BOXES.

RISER DIAGRAM
SCALE: 1/4" = 1'-0"

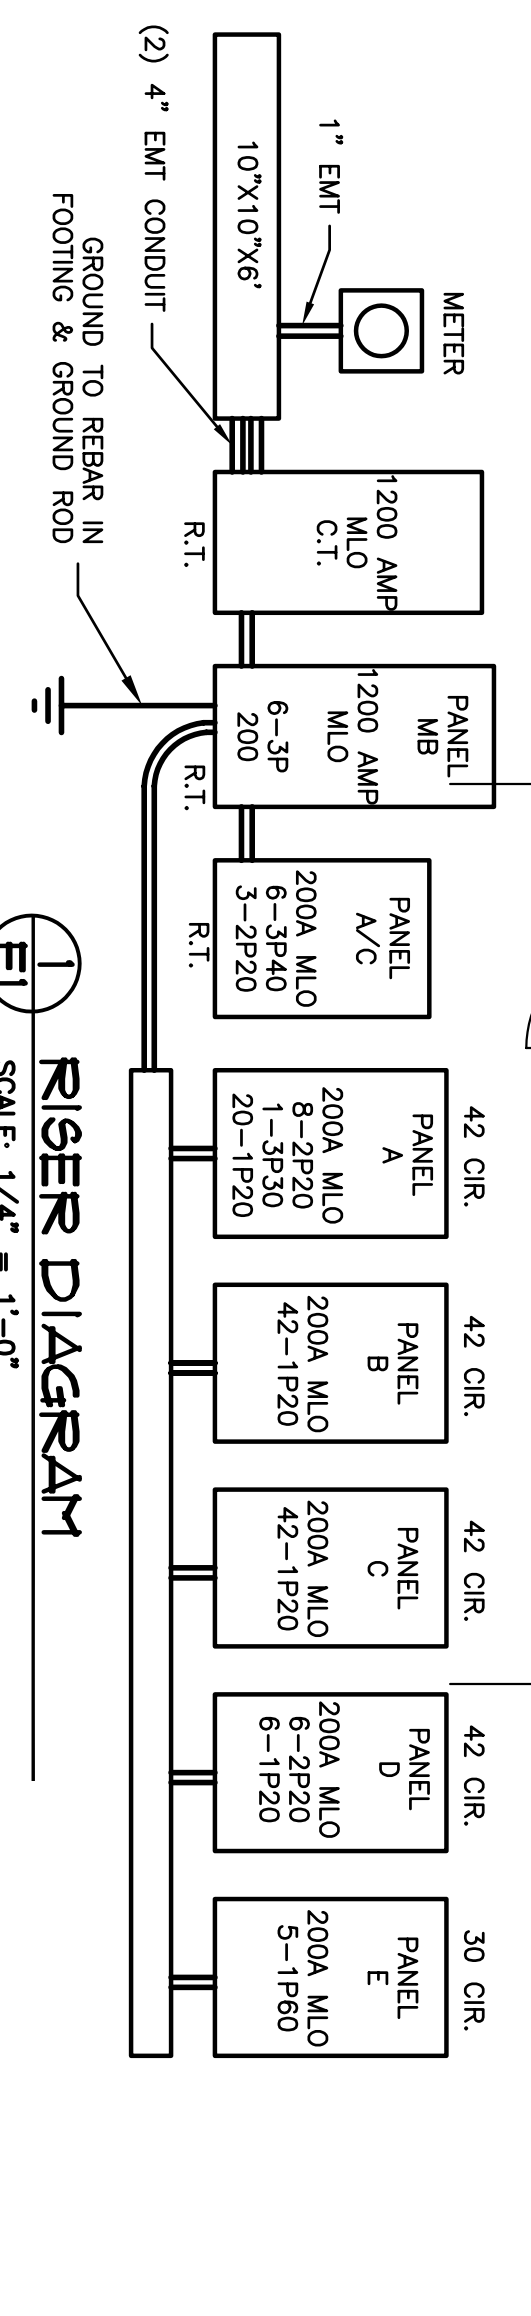

WILKERSON
PROPERTIES INC.

Commercial & Industrial Development, Management & Brokerage
Phone: (806) 474-2223
Fax: (806) 474-2216
501 E. 66th Street
Lubbock, Texas 79404

SANTIA FE PARK-LOT 33-SUITE 500
6112 43rd Street
Lubbock, Texas 79407

Date: 10/24/2008
Drawn by: JMT, JMS, MRK
Checked by: PET

Rev: 11/17/2008
Notes:

Approved by:
Boyer Lubbock
CrosScience Santa Fe 32 LP LTD.

Arec:

E1